



Date

APRIL 2023

Scale


N.T.S.

TOTBM STD.

4.8.4.B

LOCAL RURAL ROAD RECONSTRUCTION 20m R.O.W - CROSS-SECTION

Town of the Blue Mountains Standard Drawings

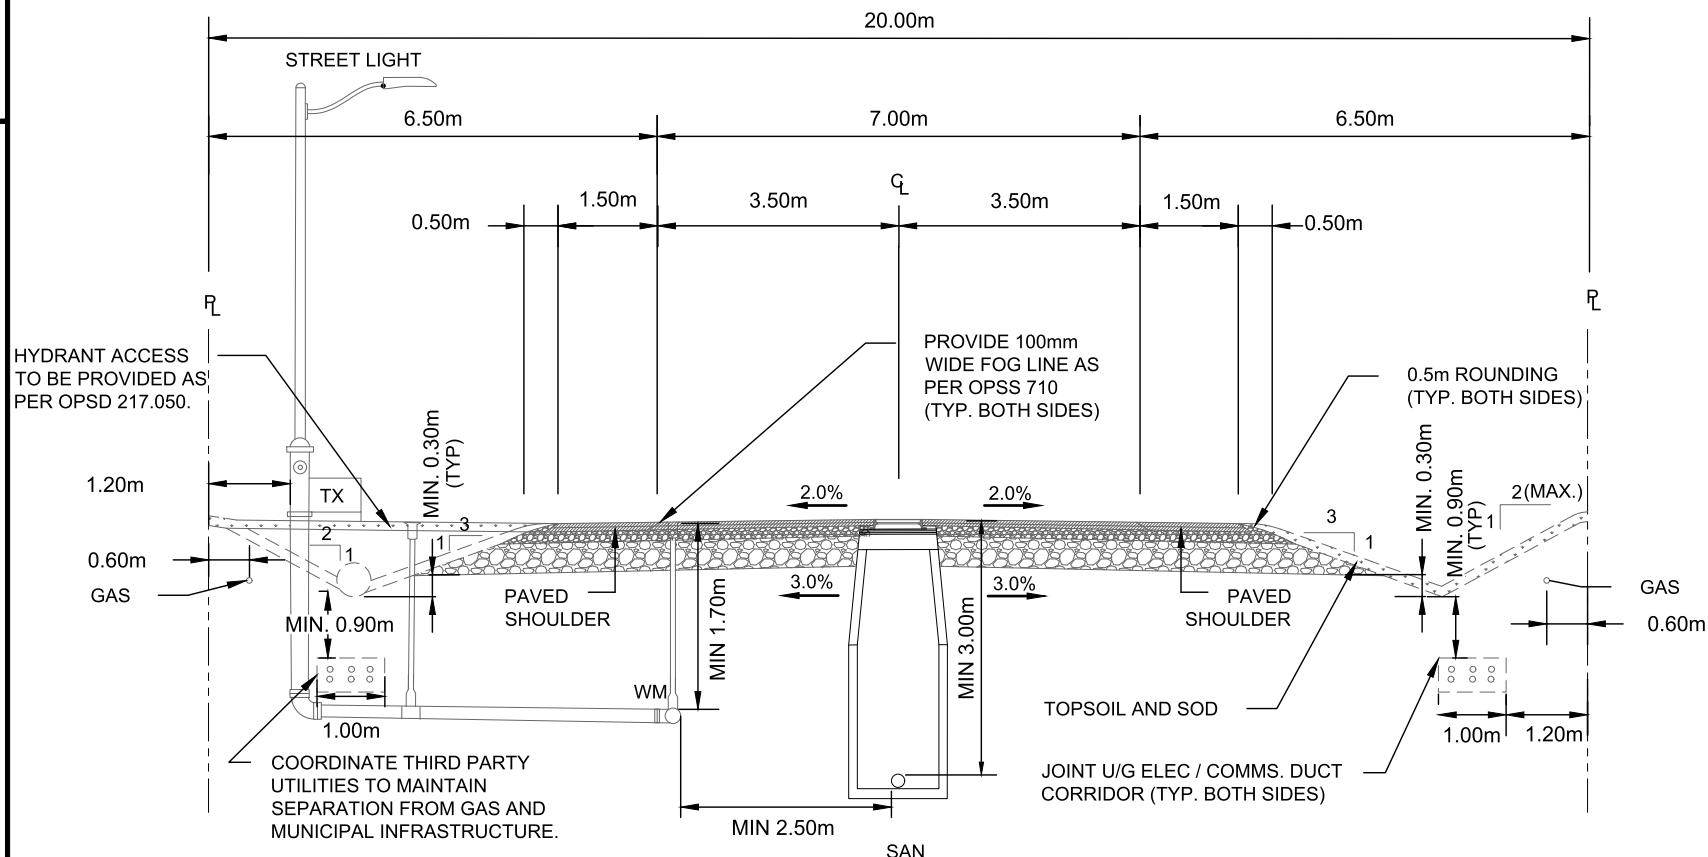

NOTES:

1. MINIMUM PAVEMENT STRUCTURE TO BE:

CLASSIFICATION	ASPHALT		GRANULAR	
	SURFACE	BASE	GRANULAR A	GRANULAR B
LOCAL RESIDENTIAL AND MINOR COLLECTOR	50mm HL3	50mm HL4 OR HL8	150mm	450mm

2. WATER SERVICES TO BE DIPPED TO MAINTAIN 1.70m COVER UNDER DITCHES.
3. TO BE READ IN CONJUNCTION WITH TOTBM STD DWG 4.8.4.A.
4. INSULATE HYDRANT LEAD UNDER DITCH WHERE COVER IS LESS THAN 1.7m. DIP HYDRANT LEAD AND INSULATE IF MINIMUM 1.2m COVER UNDER DITCH CANNOT BE ACHIEVED.