

Executive Summary

This report provides an assessment of water and wastewater treatment systems capacity within the Town for 2023. Current Town water supply and wastewater treatment infrastructure includes:

- The Blue Mountains Water Treatment Plant & Distribution System
- Supplemental water supply from the Town of Collingwood
- Thornbury Wastewater Treatment Plant & Collection System
- Craigeleith Wastewater Treatment Plant & Collection System

According to Ministry of the Environment Conservation and Parks (MECP) Guideline D-5-1 entitled “Calculating and Reporting Uncommitted Reserve Capacity at Sewage and WTPs”, “The number of lots in approved plans of subdivisions, developments committed by virtue of approved zoning, new official plans or site-specific official plan amendments, should not exceed the design capacity of the sewage and/or water system. To ensure that capacity is not exceeded it is necessary to determine what uncommitted reserve capacity is available. This procedure provides a means for determining uncommitted reserve capacity.”¹ *** See note in TWWTP for modified calculation method.

Key Definitions: Allocations versus Reservations

Built capacity	Servicing capacity of existing built Town WTP and WWTP facilities and associated infrastructure (e.g. distribution and collections systems).
Design capacity	Servicing capacity of planned Town water supply and wastewater treatment facilities and associated infrastructure based on designed and approved capacity, typically available when an ECA is obtained.
Allocation*	Commitment of built plant capacity; and “allocation of servicing capacity” or “allocated servicing capacity” shall have a corresponding meaning.
Reservation*	Commitment of approved design capacity, available when design is completed, and approvals are obtained and “reservation of servicing capacity” or “reserved servicing capacity” shall have a corresponding meaning.

* To determine units available for allocation, built capacity will be used. To determine units available for reservation, planned and approved capacity (e.g. facility design complete, ECA obtained) will be used. If no planned or approved capacity is available, the total capacity for reservation and allocation is the built capacity.

¹ MECP guideline D-5-1 entitled, “Calculating and Reporting Uncommitted Reserve Capacity at Sewage and WTPs”, updated March 1995.

Water Supply

1. Total Blue Mountains WTP Capacity

The firm capacity available from the Blue Mountains WTP is 15,140 m³/day. The Town receives up to 1,250 m³/day supplemental supply from the Town of Collingwood.

Therefore, the total firm water capacity available is 16,390 m³/day or 16,006 units based on the 5-year rolling MDD of 1.024 m³/unit/day.


2. Available Water Capacity

A total demand of 11,134 m³/day (10,873 units) is currently connected or allocated to the water system based on a 5-year rolling average maximum daily demand of 1.024 m³/unit/day.

A total flow of 2,641 m³/day (2,579 units) is currently reserved at 1.024 m³/unit/day.

Of the 16,006 total units of water supply available, there are currently 13,452 units allocated and reserved. Therefore, the current available capacity of the Town's water supply is 2,554 units.

Town Water Unit Capacity

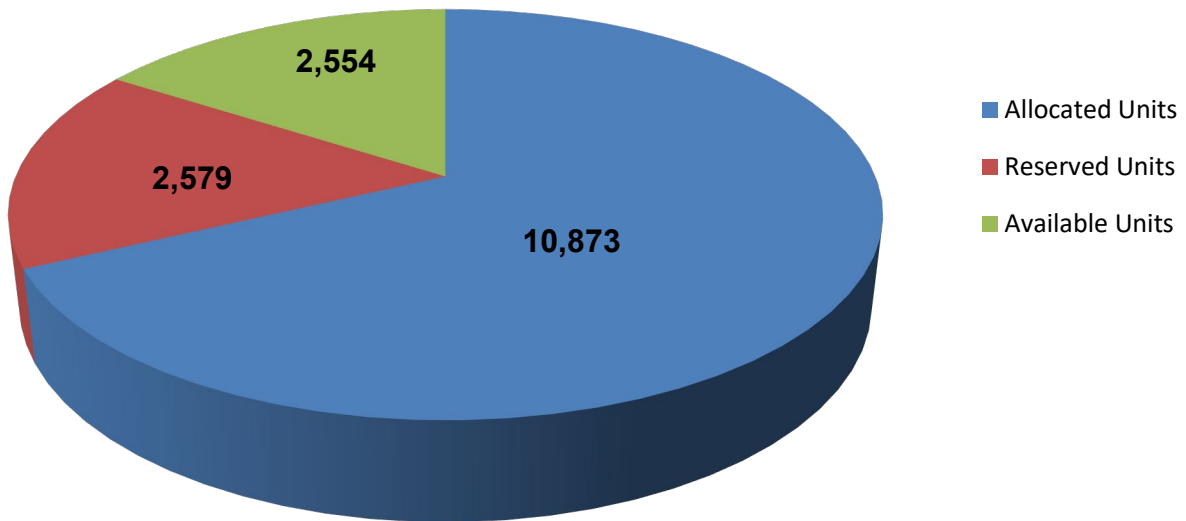

Thornbury Wastewater Treatment Plant

1. Total Thornbury WWTP Capacity

The total firm ADF built capacity available at the Thornbury WWTP is 3,580 m³/day or 4,091 units based on the 5-year rolling ADF of 0.875 m³/unit/day.

2. Available Wastewater Capacity Based on Planning Projections

A total flow of 3,214 m³/day (3,673 units) is currently connected or allocated to the Thornbury WWTP based on a 5-year rolling ADF. There are currently 3,673 units allocated and 203 reserved. Therefore, using planning projections the current available uncommitted reserve capacity based on built capacity is 215 units. However, as shown below not all units are physically connected.

The Thornbury WWTP is quickly approaching capacity based on allocated and reserved units. However, there are 477 units (203 reserved + 274 can connect) which are not physically connected to the Thornbury WWTP.


The MECP guideline for Year End reporting has been modified through discussion between the Town, Grey County and the MECP. The purpose of the modified method is to optimize the use of the Thornbury WWTP built capacity prior to commencing construction of additional capacity. Upon completion of construction of all proposed Phase 1A works, for which the Town has approval to construct, the ADF Design Capacity available will be 5,330 m³/d or 6,091 units based on an ECA received in 2019. Therefore, the current available uncommitted reserve capacity based on design capacity is 2,215 units.

The PDF flow at the Thornbury WWTP in 2023 was 9,218 m³/day. The design PDF for the Thornbury WWTP is 7,196 m³/d. The PDF typically occurs during a period of snow melt or a significant wet weather event. The peak day occurred on April 5, 2023, during a heavy rain event. The peak flow event did exceed the peak capacity of the treatment plant.

3. Thornbury WWTP Estimated Expansion Timeline

The Town has commenced with the expansion of the Thornbury WWTP. It is anticipated that the work will be completed in the second quarter of 2025. The Thornbury WWTP is operating at 76% of the built capacity based on a 5- year rolling average.

Thornbury WWTP Unit (Design) Capacity

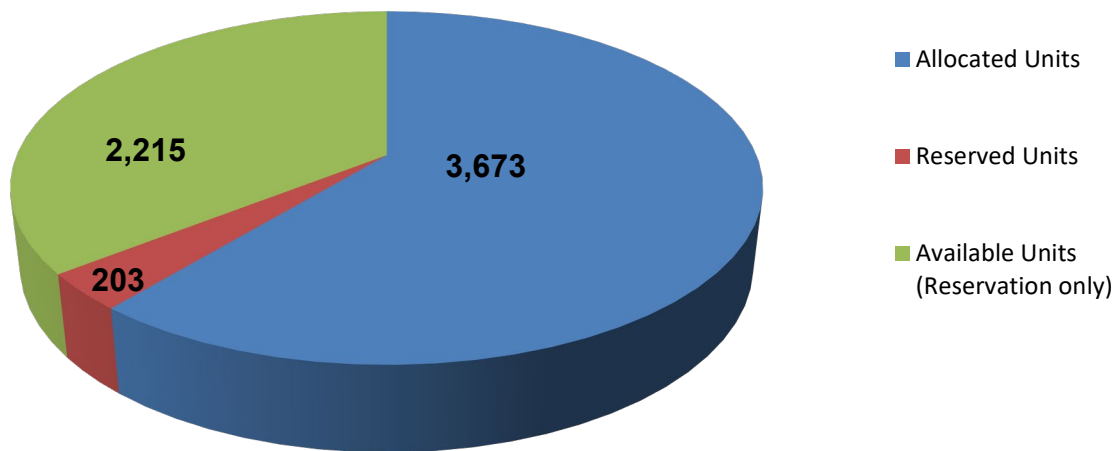

Craigleith Wastewater Treatment Plant

1. Total Craigleith WWTP Capacity

The total firm ADF built capacity available at the Craigleith WWTP is 8,133 m³/day or 12,708 units based on the 5-year rolling ADF of 0.640 m³/unit/day.

2. Available Wastewater Capacity

A total flow of 3,850 m³/day (6,015 units) is currently connected or allocated to the Craigleith WWTP, based on a 5-year rolling ADF. There are currently 6,014 units allocated and 2,571 units reserved. Therefore, the current uncommitted reserve capacity on built capacity is 4,122 units.

The PDF flow at the Craigleith WWTP in 2023 was 8,892 m³/day. This was on January 1, 2023. The design PDF for the Craigleith WWTP is 19,640 m³/d. The PDF typically occurs during a period of significant wet weather or a snow melt event.

3. Craigleith WWTP Estimated Expansion Timeline

Based on the 2023 five (5) year rolling ADF of 3,452 m³/day, the Craigleith WWTP is operating at 42% of the built capacity and as such, there is no immediate need to expand the Craigleith WWTP.

Craigleith WWTP Unit Capacity

